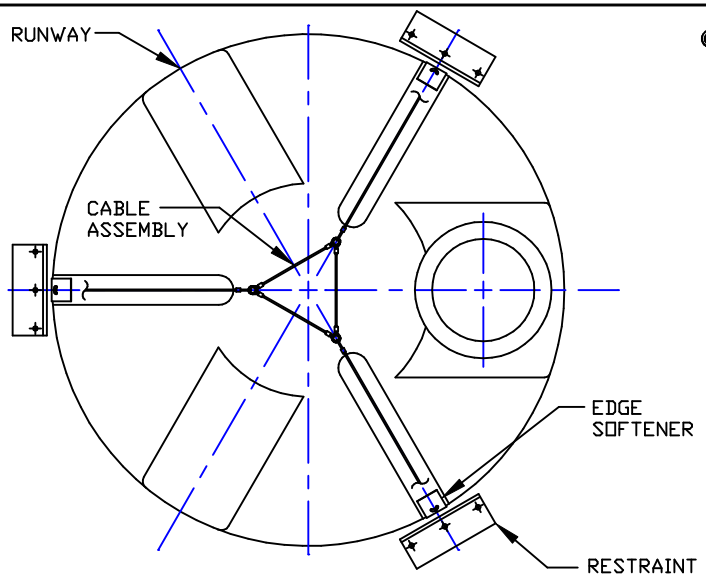

3-WAY CABLE / 3 RESTRAINT CLIP LAYOUT
(SEE NOTES 3 & 4)

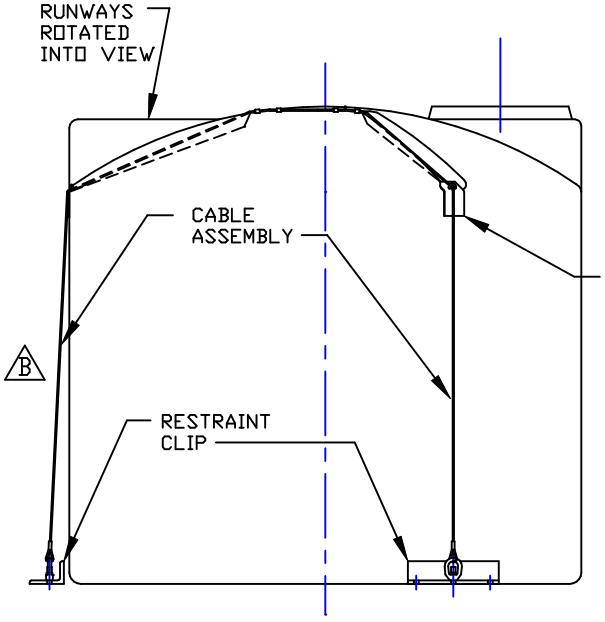

3-WAY CABLE / 3 RESTRAINT CLIP ELEVATION VIEW

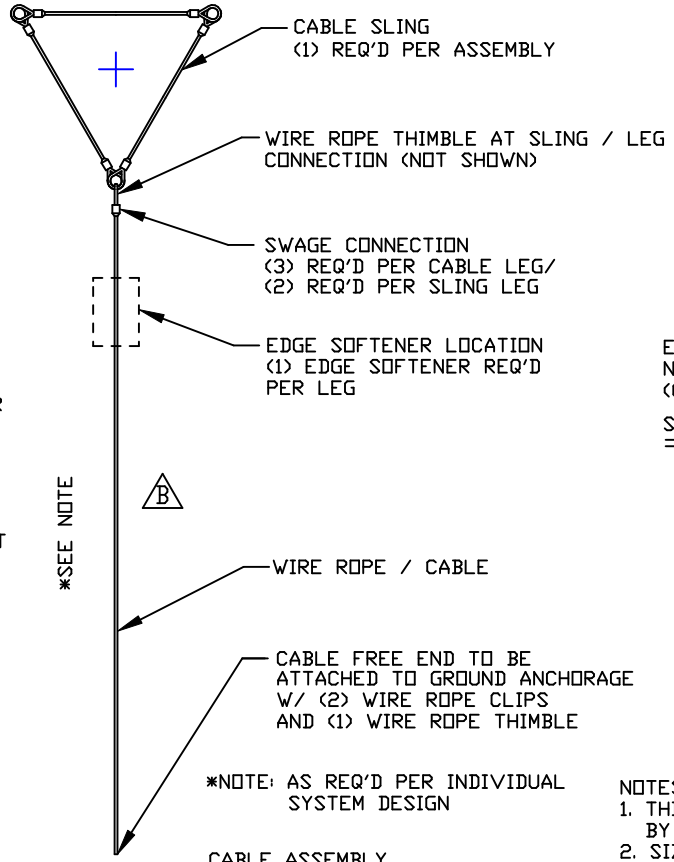

CABLE ASSEMBLY
(ONE LEG SHOWN)



EDGE SOFTENER FOR NON-INSULATED TANKS
(CABLE NOT SHOWN)

SIZE: ES

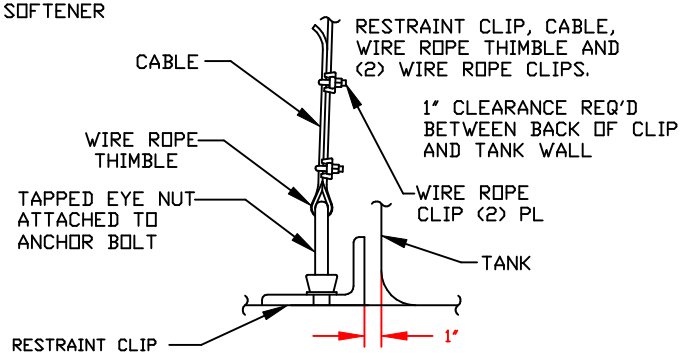

RESTRAINT CLIP/CABLE CONNECTION

NOTES:
1. THIS IS A COMPUTER GENERATED DRAWING. DO NOT REVISE BY HAND.
2. SIZE AND QUANTITY OF RESTRAINT CLIPS, CABLE LEGS AND OTHER COMPONENTS MAY VARY ACCORDING TO TANK SIZE AND RESTRAINT SYSTEM RATING.
3. RESTRAINT SYSTEM MAY CONSIST OF RESTRAINT CLIPS ONLY.
4. ANCHOR BOLTS TO BE SUPPLIED BY OTHERS.
5. ANCHOR BOLT LENGTH, EMBEDMENT AND METHOD OF ANCHORAGE TO BE DETERMINED BY A FOUNDATION ENGINEER UPON INSPECTION OF THE INSTALLATION SITE AND REVIEW OF THE APPLICABLE LOADS.

REV "A" REMOVED INSULATED EDGE SOFTENERS BY:JB 10-14-02 CK:MBW
REV "B" REMOVED TURNBUCKLES BY:JB 10-14-02 CK:MBW

DWG TITLE
RESTRAINT SYSTEM FOR VERTICAL TANKS

SCALE: 1/2"=1'-0"	POLY PROCESSING Company	Central Region P.O. Box 4150 (71211) 2001 Old Sterlington Rd. Monroe, LA 71203 (318) 343-7565 FAX (318) 343-8795	DR: J. BRANTLEY
DATE: 5/17/01			CK: MB WILKERSON
	SHEET 1 OF 1	COMPUTER FILE RESTSYSA	REV B

B-5