NON-CONTROLLED COPY

INFORMATION SUBJECT TO CHANGE WITHOUT NOTICE

VERIFY REV LEVEL OF PAPER COPY WITH REV LEVEL ON PPC WEB SITE

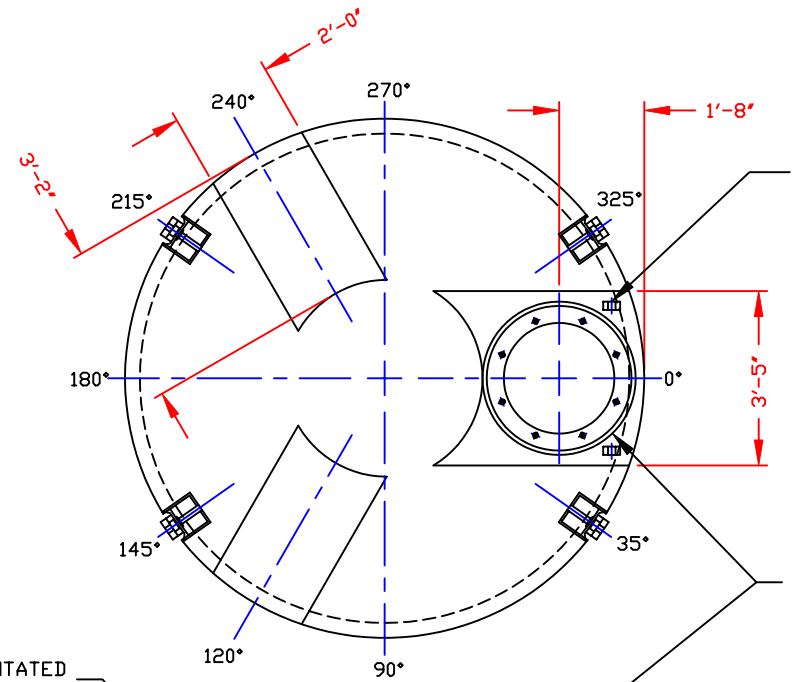

MOLDED-IN (C) LADDER ATTACHMENT LUG TYP (2) PLACES

STANDARD COVER:
24"/(8) BOLT MANWAY COVER/PE (SHOWN)
STOCK NO. 3218 OR
24"/STRAPPED MANWAY COVER/PE
STOCK NO. 3217
(OPTIONAL 24" COVERS AVAILABLE)

RUNWAYS ROTATED INTO VIEW

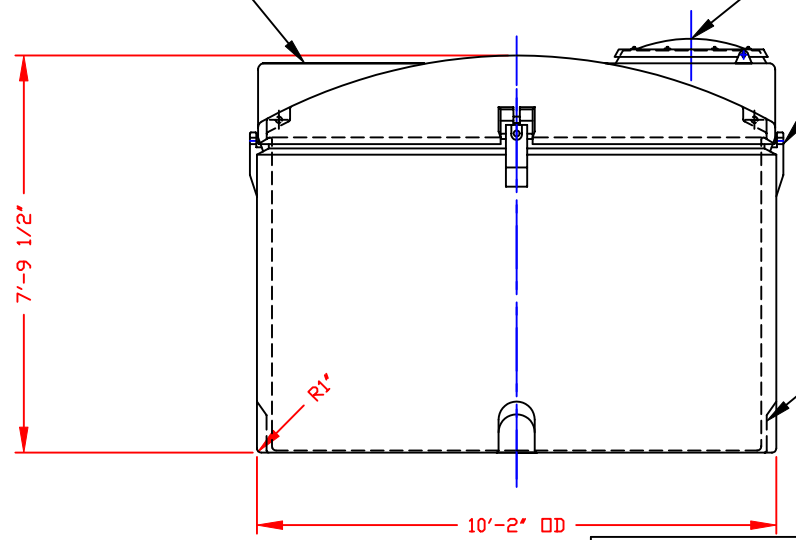

SEE LIP DTLS

(A) LUGS AND CHOCKS ROTATED INTO VIEW SEE PLAN FOR ACTUAL LOCATION

ALLIGNMENT POCKET NOT TO BE USED FOR FITTINGS

NOTE:
MUST USE FLEXIBLE CONNECTIONS ALL LOWER SIDEWALL FITTINGS (B)

NOZZLE SCHEDULE & ACCESSORIES

SERVICE	MK	STOCK NO.	SIZE	FITTING	DEG	ELEV



LIP DETAIL
SCALE: 1 1/2" = 1'-0"

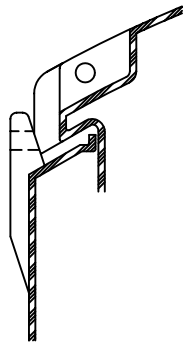

LIP DETAIL AT LUG
SCALE: 1 1/2" = 1'-0"

NOTES:
1. THIS IS A COMPUTER GENERATED DWG. DO NOT REVISE BY HAND.
2. DIMENSIONS WILL VARY ±3% DUE TO VARIATIONS IN MULTIPLE MOLDS & CONDITIONS PREVALENT DURING MANUFACTURE & USAGE.
3. FOR INNER TANK DTLS SEE COMPUTER FILE NO. 2003150, TITLE "3150 GALLON INNER SAFE-TANK" FOR OUTER TANK DTLS SEE COMPUTER FILE NO. 2103550, TITLE "3150 GALLON OUTER SAFE-TANK/3550 GALLON OPEN TOP TANK".
4. OVERALL HEIGHT DIMENSION WILL VARY WITH THE PENETRATION OF THE INNER TANK INTO THE OUTER TANK.

CALCULATED CAPACITIES/ VOLUME IN U.S. GALLONS

TANK	DESIGN CAP	DOME VOL	TOTAL VOL
INNER	3191	419	3610
OUTER	3551	N/A	3551

CONFIDENTIAL PROPERTY OF POLY PROCESSING COMPANY NOT FOR REPRINT OR USE WITHOUT PERMISSION

REV	DESCRIPTION	BY		CK	
C	ADDED LADDER ATTACHMENT LUGS	JB	10/1/04	WM	
B	ADDED FITTING NOTE	MBW	4/16/03	JB	
A	MODIFICATION TO MOLD	MBW	9/10/02	JB	

DWG TITLE: 3150 GALLON SAFE-TANK ASSEMBLY

SCALE: 3/8"=1'-0"

DATE: 12/15/00

POLY PROCESSING COMPANY

Central Region
P.O. Box 4150 (71211)
2201 Old Sterlington Rd.
Monroe, LA 71203
(318) 343-7565
FAX (318) 343-8795

DR: J BRANTLEY

CK: MB WILKERSON

SHEET	COMPUTER FILE	REV
1 OF 1	2003150A	C