



NON-CONTROLLED COPY

INFORMATION SUBJECT TO CHANGE WITHOUT NOTICE


COPY WILL NOT BE UPDATED

COPY ISSUED BY _____

COPY ISSUED ON _____

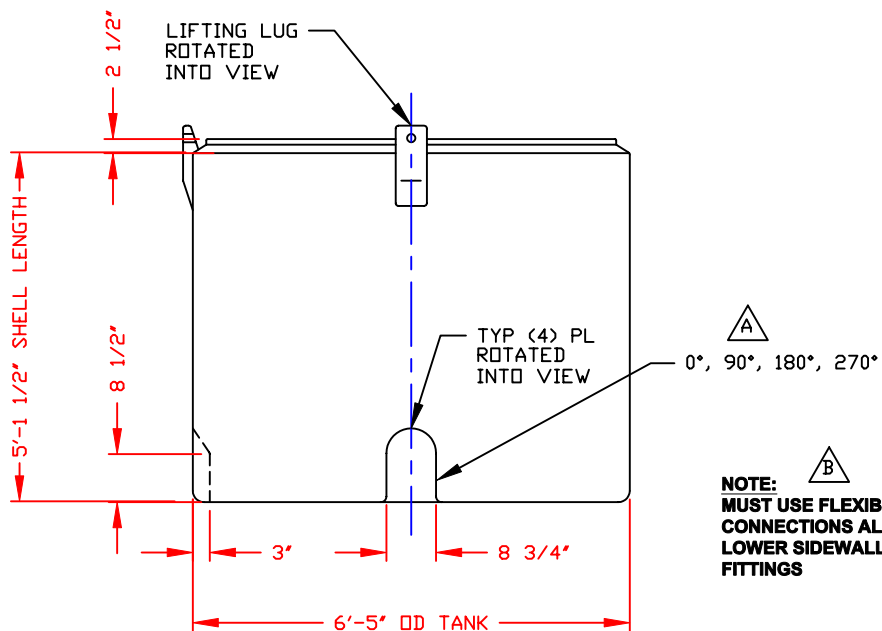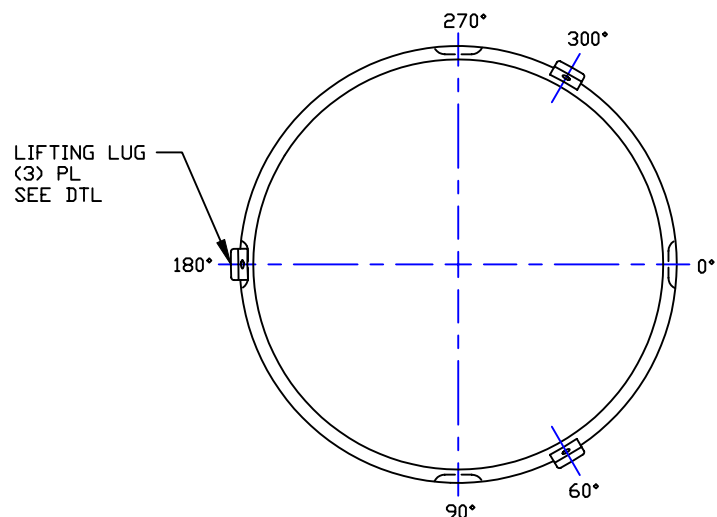

NOTE:
MUST USE FLEXIBLE
CONNECTIONS ALL
LOWER SIDEWALL
FITTINGS

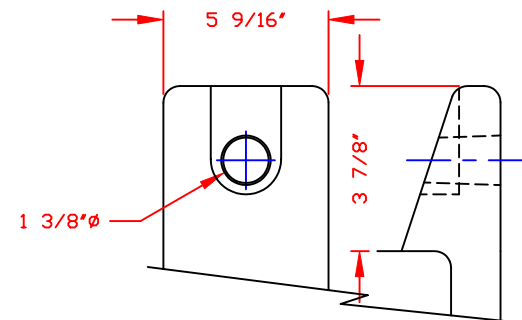

LUG DETAIL
SCALE: NONE

NOTES:

1. THIS IS A COMPUTER GENERATED DWG. DO NOT REVISE BY HAND.
2. DIMENSIONS WILL VARY ±3% DUE TO VARIATIONS IN MULTIPLE MOLDS & CONDITIONS PREVALENT DURING MANUFACTURE & USAGE.
3. FOR INNER TANK DTLS SEE COMPUTER FILE NO. 12001000. TITLE '1000 GALLON INNER SAFE-TANK.' FOR ASSEMBLY SEE COMPUTER FILE NO. 12001000A, TITLE '1000 GALLON SAFE-TANK ASSEMBLY.'

CALCULATED CAPACITY VOLUME IN U.S. GALLONS
DESIGN CAPACITY
1215

CONFIDENTIAL PROPERTY OF
POLY PROCESSING COMPANY
NOT FOR REPRINT OR USE
WITHOUT PERMISSION

DWG TITLE		1000 GALLON OUTER SAFE-TANK/ 1200 GALLON OPEN TOP TANK	
SCALE:	1/2"=1'-0"	POLY PROCESSING Company	Western Region P.O. Box 88 6025 South Ash Street French Camp, CA 95831 (209) 982-4304 FAX (209) 982-0435
DATE:	6/28/00		DR: MB WILKERSON CK: J. BRANTLEY
REV 'B' ADDED FITTING NOTE BY:MBW 4/16/03 CK:JB		SHEET	COMPUTER FILE
REV 'A' ADDED NOTE & POCKETS IN IN PLAN VIEW BY:JB 1/28/02 CK:WM		1 OF 1	12101200
			B