



NON-CONTROLLED COPY	COPY ISSUED BY _____
INFORMATION SUBJECT TO CHANGE WITHOUT NOTICE	COPY ISSUED ON _____
COPY WILL NOT BE UPDATED	

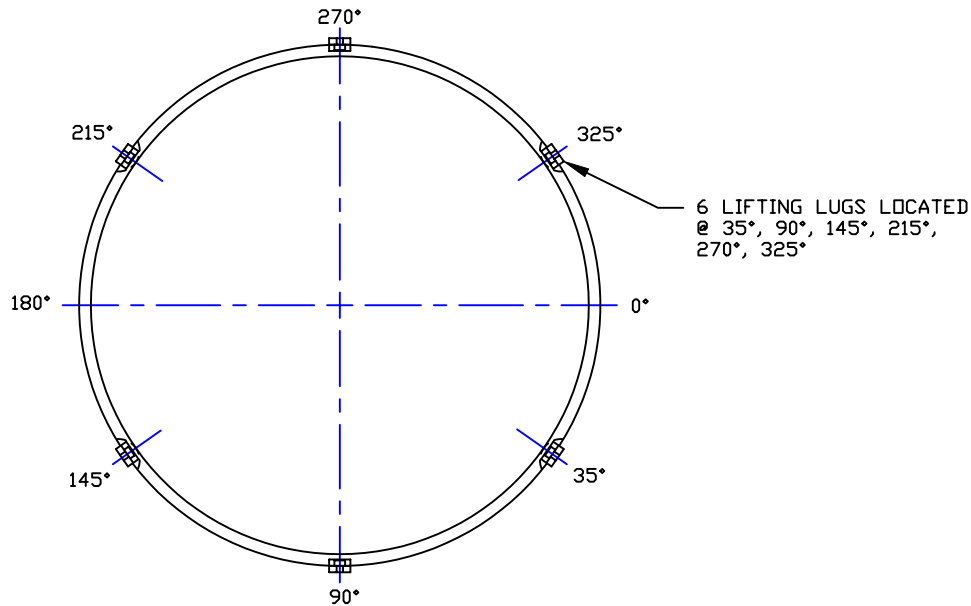


6 LIFTING LUGS LOCATED @ 35°, 90°, 145°, 215°, 270°, 325°

NOZZLE SCHEDULE & ACCESSORIES						
SERVICE	MK	STOCK NO.	SIZE	FITTING	DEG	ELEV

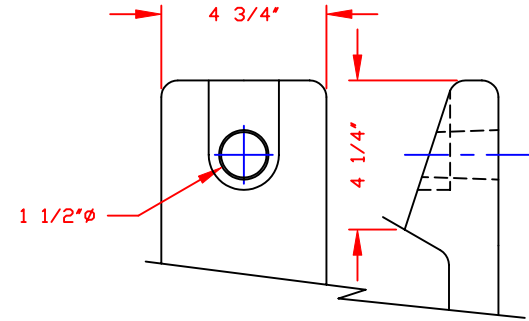

LUG DETAIL "A"
SCALE: 1 1/2" = 1'-0"

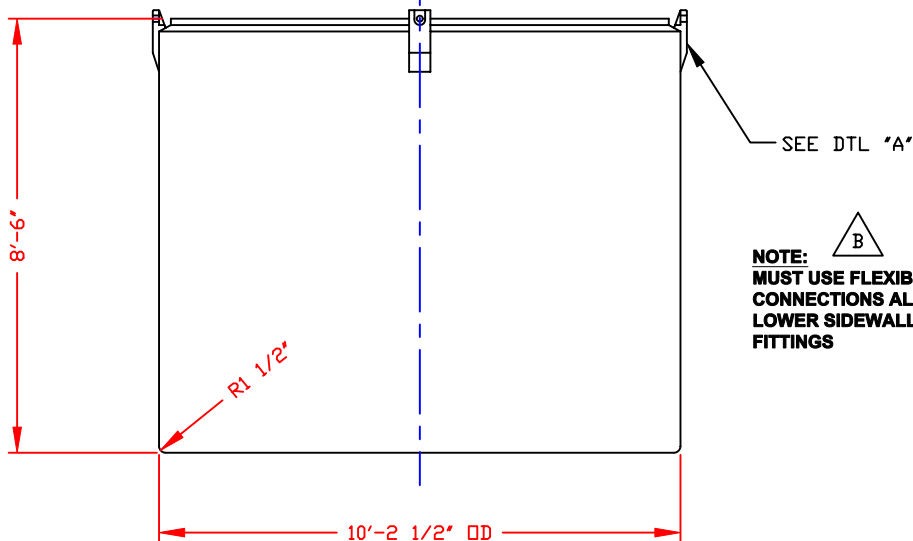

NOTE: MUST USE FLEXIBLE CONNECTIONS ALL LOWER SIDEWALL FITTINGS

NOTES:

1. THIS IS A COMPUTER GENERATED DWG. DO NOT REVISE BY HAND.
2. DIMENSIONS WILL VARY $\pm 3\%$ DUE TO VARIATIONS IN MULTIPLE MOLDS & CONDITIONS PREVALENT DURING MANUFACTURE & USAGE.
3. NO MOLDED IN GALLONAGE MARKERS THIS TANK.
4. FOR INNER TANK DTLS SEE COMPUTER FILE NO. 2004400, TITLE "4400 GALLON INNER SAFE-TANK." FOR ASSEMBLY DTLS SEE COMPUTER FILE NO. 2004400A, TITLE, "4400 GALLON SAFE-TANK ASSEMBLY."

CALCULATED CAPACITY
VOLUME IN U.S. GALLONS
DESIGN CAPACITY
4994

CONFIDENTIAL PROPERTY OF
POLY PROCESSING COMPANY
NOT FOR REPRINT OR USE
WITHOUT PERMISSION

DWG TITLE		4400 GALLON OUTER SAFE-TANK/ 4950 GALLON OPEN TOP TANK	
SCALE: 3/8"=1'-0"		Central Region P.O. Box 4150 (7121) 2281 Old Stoneington Rd. Morgan, LA 71250 504-343-7245 FAX 504-343-8795	DR: MB WILKERSON CK: D. RECTOR
DATE: 12/7/99		SHEET	COMPUTER FILE
REV "B" ADDED FITTING NOTE BY:MBW 4/16/03 CK:JB REV "A" REDRAWN SHOWING MOLD MODIFICATIONS BY:MBW 5/15/02 CK:JB		1 OF 1	2104950 B